



深圳市蓝宝安科电子有限公司

Shenzhen LanbaoAnke Electronics Co.,Ltd.

# 承 认 书

## APPROVAL SHEET

|         |           |
|---------|-----------|
| 编号 NO.  | LB-DPB-01 |
| 版次 Ver. | A/3       |

|                |  |
|----------------|--|
| 客户<br>Customer |  |
|----------------|--|

|               |                |
|---------------|----------------|
| 品名<br>Product | 三端保险丝          |
| 系列<br>Series  | DPBxx30 Series |

| 料号Part No.      | 规格描述Specification | 备注Remark |
|-----------------|-------------------|----------|
| 蓝宝<br>LB fuse   |                   |          |
| 客 户<br>Customer |                   |          |

| 供应商-蓝宝<br>Supplier-LB fuse | 零件承认章<br>Approval Signet                                                            | 客户<br>Customer | 零件承认章<br>Approval Signet |
|----------------------------|-------------------------------------------------------------------------------------|----------------|--------------------------|
| 制作<br>Make                 |  |                |                          |
| 审查<br>Check                |                                                                                     |                |                          |
| 批准<br>Approval             |                                                                                     |                |                          |

| 联络Contact         |             |             |                    |
|-------------------|-------------|-------------|--------------------|
| 业务Sales           | 电话Telephone | 手机Cellphone | 邮箱E-mail           |
|                   |             |             | lanbaofuse@163.com |
| 零件承认后敬请回签一份给我司留存。 |             |             |                    |

History of Change变更记录

| NO. | 日期<br>Date | 描述<br>Description | 版次<br>Edition | 修改<br>modified by | 审核<br>Checked by                                                                    |
|-----|------------|-------------------|---------------|-------------------|-------------------------------------------------------------------------------------|
| 1   | 2022.05.20 | 新制订               | A/1           | 牛文博               |  |
| 2   | 2023.04.03 | 更改为新封面            | A/2           | 牛文博               |  |
| 3   | 2025.05.07 | 新增单颗重量、注解、注意事项    | A/3           | 牛文博               |  |
| 4   |            |                   |               |                   |                                                                                     |
| 5   |            |                   |               |                   |                                                                                     |
| 6   |            |                   |               |                   |                                                                                     |
| 7   |            |                   |               |                   |                                                                                     |
| 8   |            |                   |               |                   |                                                                                     |
| 9   |            |                   |               |                   |                                                                                     |
| 10  |            |                   |               |                   |                                                                                     |
| 11  |            |                   |               |                   |                                                                                     |

## 1. 适用范围 / SCOPE

DPB 系列三端保险丝，保护锂离子电池免受过电流和过电压的影响，适用于一般电子设备。

DPB Series Resistor Embedded Protector, Protect Li-ion battery from the overcurrent and the overcharge

## 2. 产品编码标示/ Part Numbering Marking

例「example」：



Company logo

Model Mark (XX represents different voltage platforms, 30 represents rated current 30A)

DPB:B Series/ (5.4\*3.2\*1.35mm)

## 3. 电气特性 / ELECTRICAL CHARACTERISTICS

| Part Number | I <sub>rated</sub><br>(A) | Cells in series | V <sub>max</sub><br>(V <sub>DC</sub> ) | I <sub>brek</sub><br>(A) | V <sub>op</sub><br>(V) | R <sub>fuse</sub><br>(mΩ) | Agency Approval                                                                     |
|-------------|---------------------------|-----------------|----------------------------------------|--------------------------|------------------------|---------------------------|-------------------------------------------------------------------------------------|
|             |                           |                 |                                        |                          |                        |                           |  |
| DPB0830     | 30                        | 2               | 62                                     | 80                       | 6.6~9.0                | 0.5~2.5                   | E213695                                                                             |
| DPB1230     | 30                        | 3               | 62                                     | 80                       | 8~15.5                 |                           |                                                                                     |
| DPB1430     | 30                        | 4               | 62                                     | 80                       | 13.4~18.4              |                           |                                                                                     |
| DPB2030     | 30                        | 5               | 62                                     | 80                       | 17.1~23.5              |                           |                                                                                     |
| DPB2430     | 30                        | 6               | 62                                     | 80                       | 19.8~27.6              |                           |                                                                                     |
| DPB3030     | 30                        | 7               | 62                                     | 80                       | 23.0~31.5              |                           |                                                                                     |
| DPB3530     | 30                        | 8               | 62                                     | 80                       | 26.4~36.0              |                           |                                                                                     |
| DPB4030     | 30                        | 9~10            | 62                                     | 80                       | 34.2~46.9              |                           |                                                                                     |
| DPB5030     | 30                        | 12~14           | 62                                     | 80                       | 45.2~62.0              |                           |                                                                                     |
| DPB5030-3P  | 30                        | 15~16 LFP       | 62                                     | 80                       | 40.0~60.0              |                           |                                                                                     |

注解 / Annotation:

额定电流/I<sub>rated</sub>: 40℃热平衡环境温度下保险丝可以正常工作的电流。

Current carrying capacity that is measured at 40℃ thermal equilibrium condition

分断电流/I<sub>brek</sub>: 保险丝可以正常切断的最大安全电流。

The current that the fuse element able to interrupt

最大电压/V<sub>max</sub>: 保险丝可以正常切断的最大安全电压。

the maximum Voltage that can be cut off by fuse

工作电压范围/V<sub>op</sub>: 保险丝可以正常工作的电压范围。

Range of operation voltage

保险丝电阻R<sub>fuse</sub>: 保险丝元件的电阻

The resistance of the fuse element

串联单元/Cells in series: 电池串联数量

Number of battery cells connected in series in the circuit for ITV device to protect


LFP代表磷酸铁锂电池，以P做为缩写

LFP stands for lithium iron phosphate battery, abbreviated as P


#### 4. 产品工程图/测试基板尺寸 / OUTLINE DRAWING&TEST SUBSTRATE SIZE

##### 4-1 工程图（单位：mm） / Outline Drawing (Unit: mm)

**俯视图/Top View**

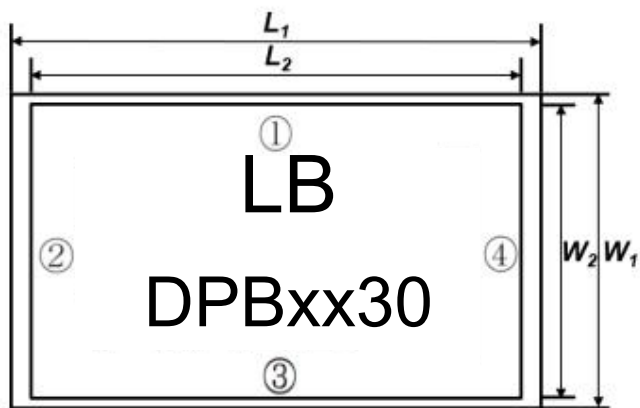


**等效电路/ Equivalent Circuit**

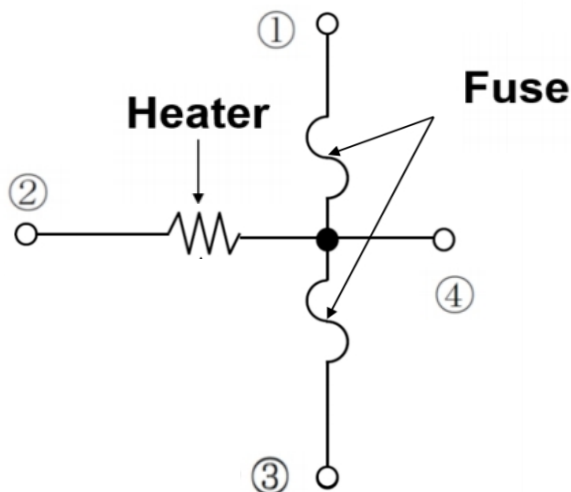

**侧视图Side View**



**底视图Bottom View**

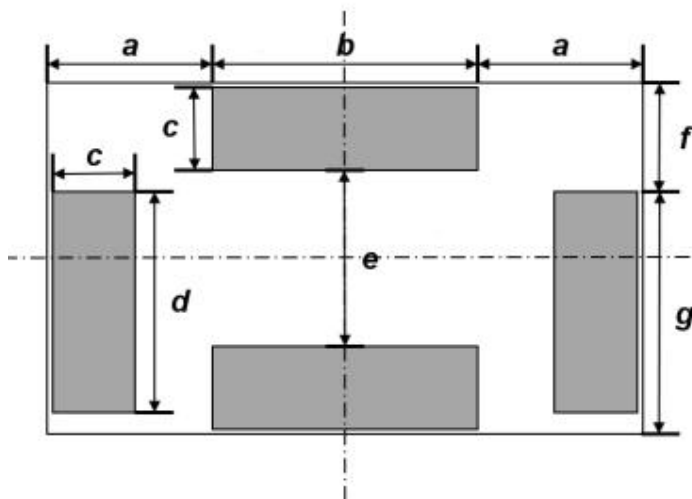

**尺寸/ Dimension**


| Code  | Dimension (mm) |
|-------|----------------|
| $L_1$ | $5.4 \pm 0.2$  |
| $L_2$ | $5.0 \pm 0.2$  |
| $W_1$ | $3.2 \pm 0.2$  |
| $W_2$ | $3.0 \pm 0.2$  |
| $T$   | $1.35 \pm 0.1$ |
| $T_1$ | 0.80           |
| $T_2$ | 0.55           |
| $a$   | 1.5            |
| $b$   | 2.4            |
| $c$   | 0.75           |
| $d$   | 2.0            |
| $e$   | 1.6            |
| $f$   | 1.0            |
| $g$   | 2.2            |

\* 无需另行通知，尺寸公差为±0.10mm/Without extra notification the tolerance is ±0.10mm

**产品单重/Weight:0.04 ± 10% grams/pcs**


4-2 测试基板尺寸 (单位: mm) / Test substrate size (Unit: mm)

测试基板尺寸 Test Circuit Board

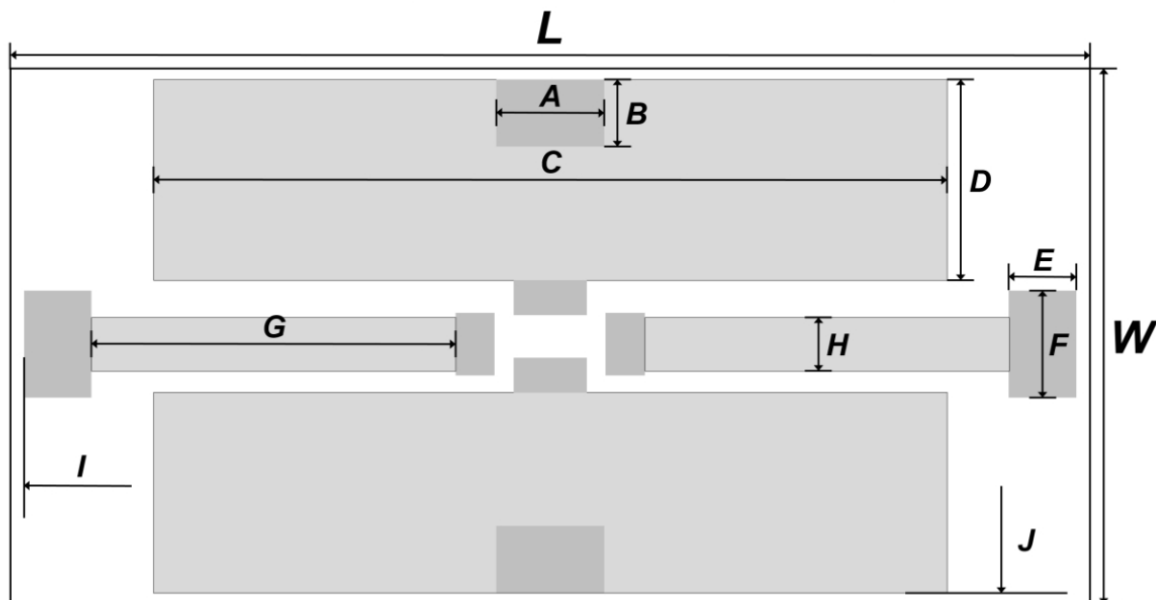

\* ①↔③为过电流保护端/Terminal ①↔③ for current fusing time & carrying capacity.

\* ①↔②或者③↔②为过压保护端/Terminal ①↔② (or ③↔②) for voltage fusing time.

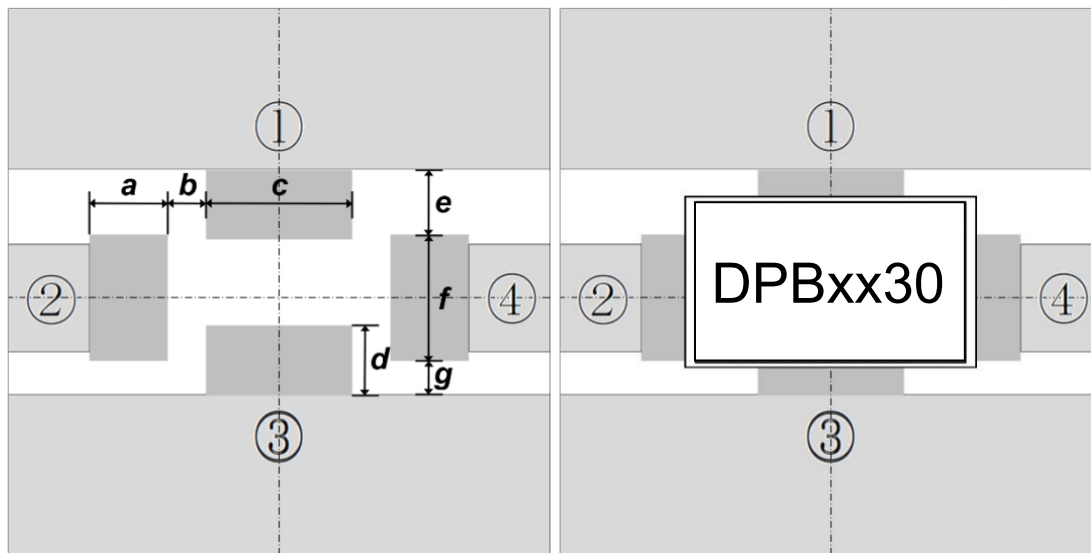


|     |                |     |                |            |                |
|-----|----------------|-----|----------------|------------|----------------|
| $L$ | $40.0 \pm 0.2$ | $F$ | $4.0 \pm 0.1$  | $c$        | $2.7 \pm 0.1$  |
| $W$ | $20.0 \pm 0.2$ | $G$ | $13.5 \pm 0.1$ | $d$        | $1.3 \pm 0.1$  |
| $A$ | $4.0 \pm 0.1$  | $H$ | $2.0 \pm 0.1$  | $e$        | $1.3 \pm 0.1$  |
| $B$ | $2.5 \pm 0.1$  | $I$ | $0.5 \pm 0.05$ | $f$        | $2.35 \pm 0.1$ |
| $C$ | $29.4 \pm 0.1$ | $J$ | $0.4 \pm 0.05$ | $g$        | $0.55 \pm 0.1$ |
| $D$ | $7.5 \pm 0.1$  | $a$ | $1.45 \pm 0.1$ | (Unit: mm) |                |
| $E$ | $2.5 \pm 0.1$  | $b$ | $0.7 \pm 0.1$  |            |                |


\*基板厚度0.60mm/Board thickness: 0.60mm\*铜箔厚度0.07mm/Copper thickness: 0.07mm(2.0oz)

## 5. 产品性能曲线/PRODUCT PERFORMANCE CURVE


5-1 I-t图/CHARACTERISTICS DIAGRAM(I-t)

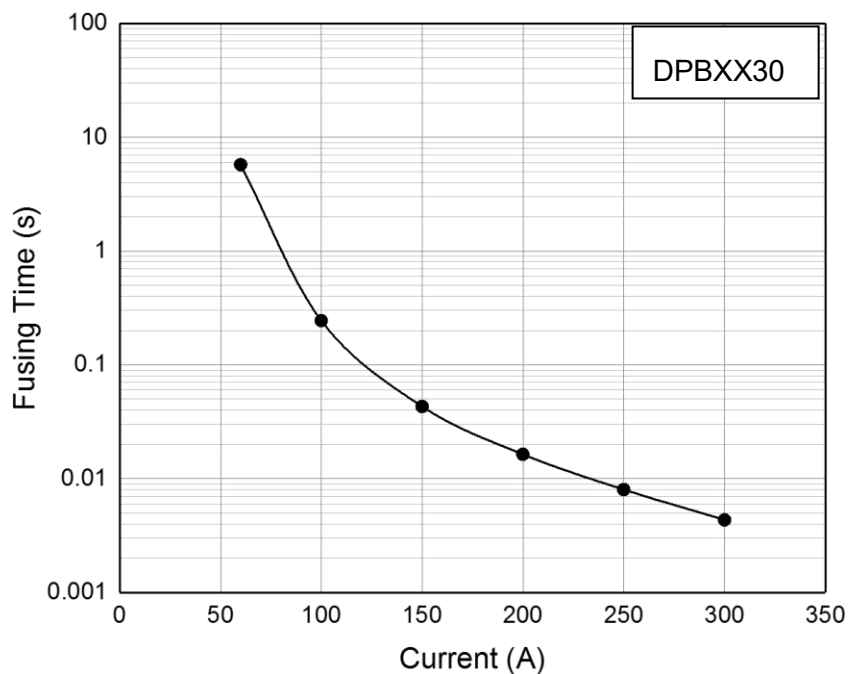


5-2 2倍I-t图/CHARACTERISTICS DIAGRAM(2\*I-t)

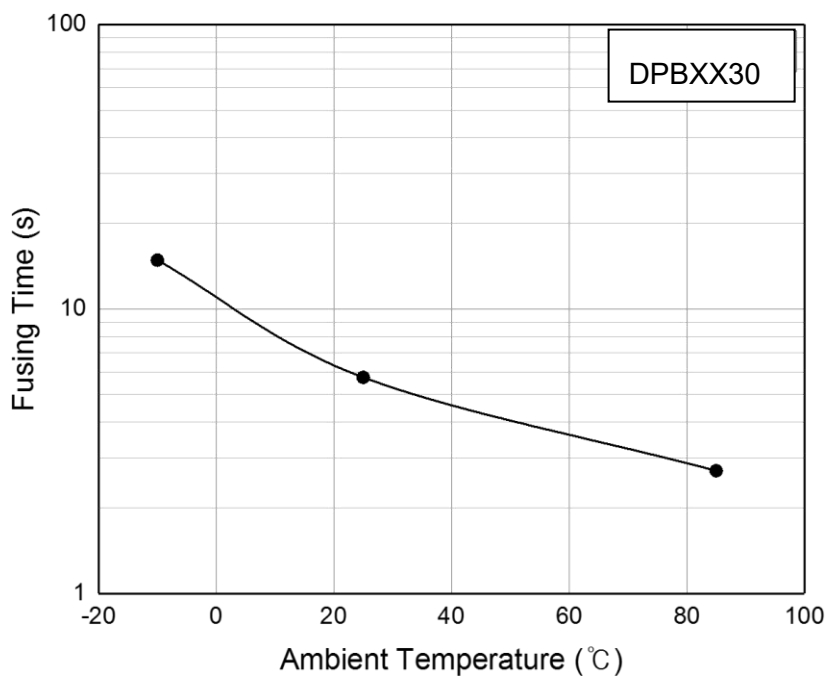


5-3 加热体功率与熔断时间曲线图/CURVE OF HEATING ELEMENT POWER AND FUSING TIME

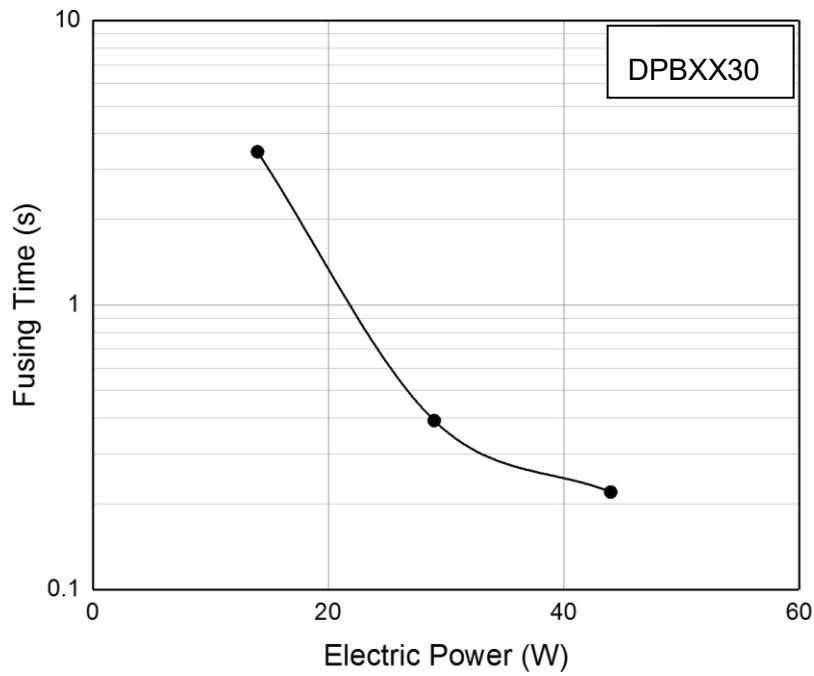

5-4 不同功率/环境温度下熔断时间曲线/FUSING TIME CURVE UNDER DIFFERENT POWER / AMBIENT TEMPERATURE

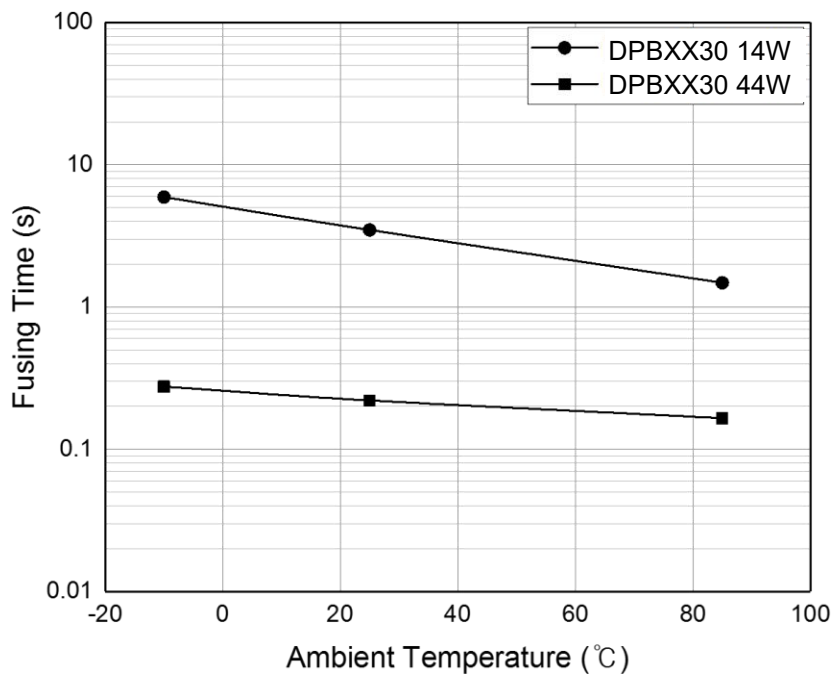


5-5 电流与环境温度曲线/CURRENT ANE AMBIENT TEMPERATURE CURVE

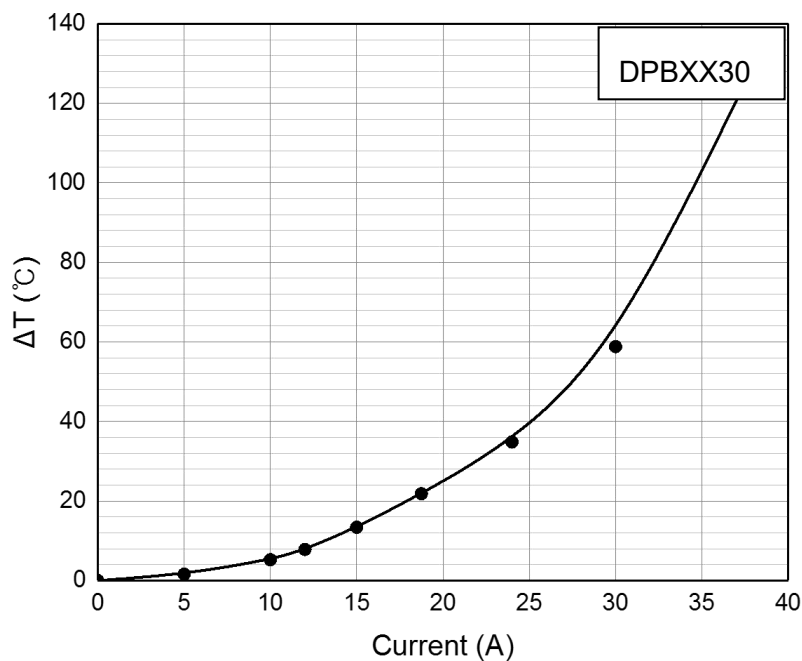

6. 建议客户焊接参数 / RECOMMENDED CUSTOMER SOLDERING PARAMETERS

6-1 回流焊曲线/REFLOW

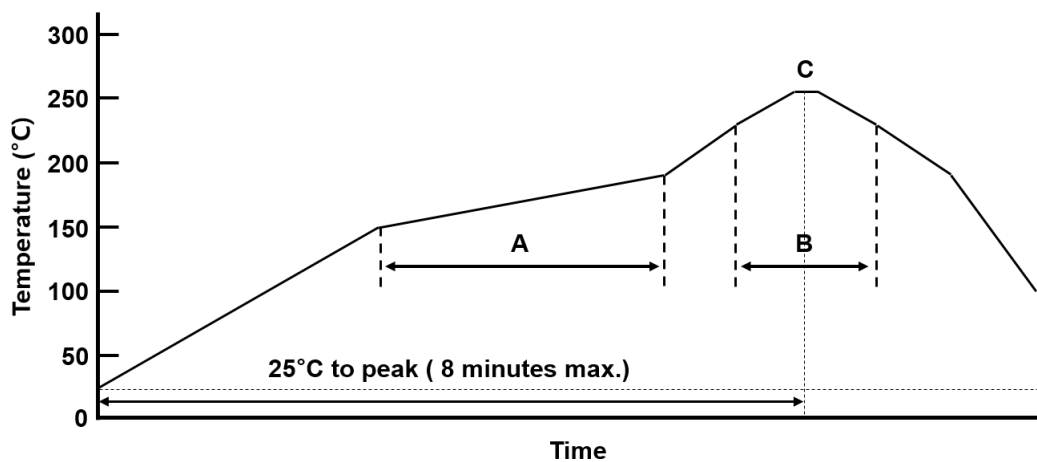

|                 | A<br>(预热段/Pre-Heating) | B<br>(峰值/Peak) | C<br>(最高温度/Peak) |
|-----------------|------------------------|----------------|------------------|
| Temperature[°C] | 150~190°C              | Over 230°C     | 255 ± 5°C        |
| Time [sec]      | 90 ± 30sec             | 25 ± 5sec      | Max. 5sec        |




## 7. 包装讯息 / PACKING INFORMATION


### 7-1 包装数量、重量 / QUANTITY & WEIGHT

| 型号Type Number | 数量Quantity(PCS) | 单颗重量Single Weight(mg) |
|---------------|-----------------|-----------------------|
| DPBXX30       | 3000            | 47 ± 12               |

### 7-2 卷轮规格/ Reel & Tape specifications

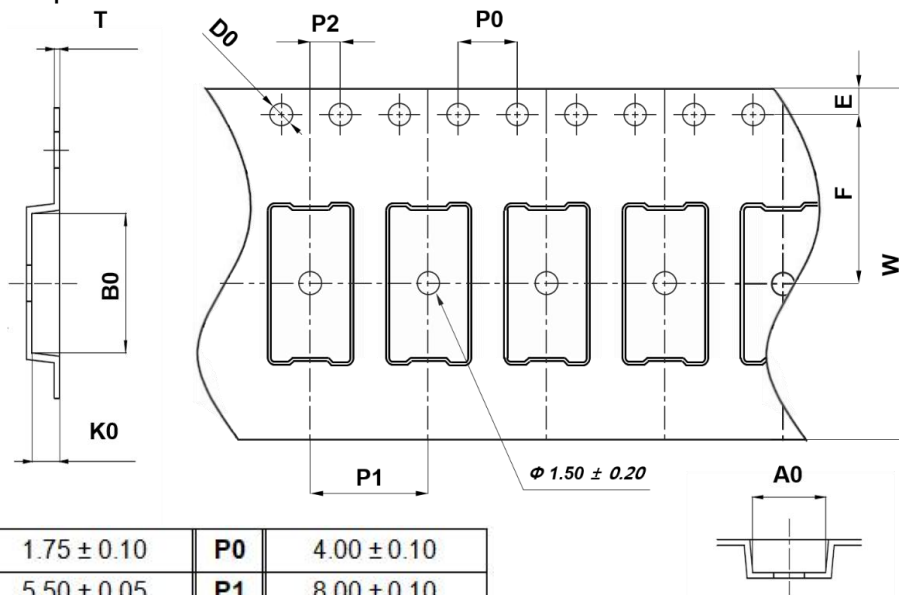

|    |             |   |              |            |             |
|----|-------------|---|--------------|------------|-------------|
| A0 | 3.50 ± 0.10 | E | 1.75 ± 0.10  | P0         | 4.00 ± 0.10 |
| B0 | 5.70 ± 0.10 | F | 5.50 ± 0.05  | P1         | 8.00 ± 0.10 |
| K0 | 1.60 ± 0.10 | T | 0.30 ± 0.05  | P2         | 2.00 ± 0.10 |
| D0 | 1.55 ± 0.05 | W | 12.00 ± 0.30 | (Unit: mm) |             |

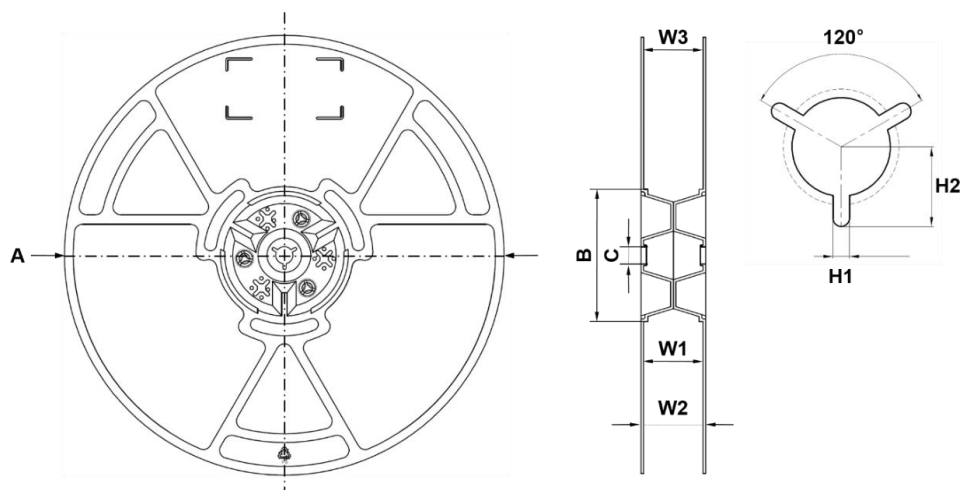

|    |             |    |             |            |             |
|----|-------------|----|-------------|------------|-------------|
| A  | 330.0 ± 2.0 | B  | 100.0 ± 1.0 | C          | 13.0 ± 0.2  |
| W1 | 12.4 ± 1.5  | W2 | 16.4 ± 2.0  | W3         | 13.65 ± 1.5 |
| H1 | 2.0 ± 0.5   | H2 | 10.5 ± 1.0  | (Unit: mm) |             |

## 8. 环境可靠性测试 / ENVIRONMENTAL RELIABILITY

| 项目Items                               | 测试条件<br>Conditions                                                                                                                                                                                                                                  | 参考标准<br>Reference standard                          |
|---------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------|
| 熔断时间<br>Fusing time                   | 通以2倍额定电流/Apply 200% of its rated current.                                                                                                                                                                                                           | 保险丝需在1分钟内断开<br>/The fuse shall be melt within 1min. |
|                                       | 产品工作电压范围的最小值应适用于发热体/The minimum value of the operating voltage range of each model shall be applied to heater.                                                                                                                                      |                                                     |
| 额定电流测试<br>Current carrying capacity   | 通以1倍的额定电流/Apply 100% of its rated current.                                                                                                                                                                                                          | 不能断开/No melting.                                    |
| 工作温度范围<br>Operating temperature range | <p>分别在-10°C至65°C的环境温度下进行如下试验/The following examinations are executed respectively within the range from -10 to 65°C.</p> <ul style="list-style-type: none"> <li>•熔断时间测试/Fusing time test</li> <li>•额定载流测试/Current carrying capacity test</li> </ul> | 保险丝应通过每次测试<br>/The fuse shall be passed each test.  |

\*电气特性受PCB板的热容量、零件、线路宽度等的影响。因此，您应该在PCB板上进行测试

Electrical characteristics are influenced by thermal capacity of PCB, parts, pattern width, etc.  
Therefore you should check them on your PCB.

### 三端保险丝使用特别说明/Handling Instructions for REP

- 请在设计前确认最新的产品信息/Please confirm the latest product information before a design.
- 储存条件/Storage Condition
  - 本产品应储存在凉爽（室温低于 40°C）和相对湿度低于 60%的干燥条件下，并远离溶剂烟雾环境。  
This products should be stored in a cool (Room temperature under 40°C) and dry condition less than 60% relative humidity and kept out of solvent fumes circumstances.
  - 拆除密封包装后，保存期为 3 个月。  
After removing the sealed packaging, the shelf life is 3 months.
- 三端保险丝应遵守的环境法规/REP complies with environmental regulation.
  - 产品符合 ROHS/REP complies with RoHS
  - 产品符合无卤素的一般要求/REP complies with general requirement for Halogen Free.
- 性能参数仅作为参考值/Performance data is typical value.
  - 这些数据并不是绝对值  
These data is not a guaranteed value.
  - 这些数据均为专用测试基板测量所得  
These data is measured with our company's standard PCB.
  - 特性受 PCB 基板热容量的影响  
The characteristics are influenced by thermal capacity of PCB.
  - 一般来说，当 PCB 的热容量增加时，载流量会增加，熔断时间会拉长  
Generally, when thermal capacity of PCB increases, current-carrying capacity will be increase and fusing time will be long.
- 处理注意事项/Precautions regarding handling
  - 请参阅“测量（第 3 页）”一节，确保本产品的端子连接在电路板的焊盘上。  
Make sure that the terminals of this product are connected on the lands of the circuit board referring to section “Measurement (pp. 3)”.
  - 超声波清洗、浸没清洗等不得在安装前后进行。清洗完成后，元件上的焊剂会流动，并且不符合其规格要求，此外，当产品与清洗液接触时，也会产生类似的影响，清洁后的这些产品将无法保证。  
Ultrasonic-cleaning of immersion-cleaning and so on must not be done to REP before and after mounted. When cleaning is done, flux on element would flow, and it would not be satisfied its specification. Moreover, a similar influence happens when the product comes in contact with cleaning-solution. These products after cleaning will not be guaranteed.

- 防止腐蚀性气体（Cl<sub>2</sub>、NH<sub>3</sub>、SO<sub>x</sub>、NO<sub>x</sub> 等）接触产品。  
Prevent corrosive gas (Cl<sub>2</sub>, NH<sub>3</sub>, SO<sub>x</sub>, NO<sub>x</sub>, etc.) from contacting the products.
  - 请不要重复使用通过手工退焊取下的产品。  
Please do not re-use of the REP removed by solder correction
  - 由于陶瓷结构的性质，过大的应力或冲击可能会使产品破裂或开裂。  
Excessive stress or shock may make products broken or cracked due to the nature of ceramics structure
  - 请不要使用密封胶将产品完全密封，完全密封将影响产品熔断性能。  
Please do not use sealant to completely seal the product, as complete sealing will affect the product's melting performance.
- 贴片返工/SMD Re-work
    - 请不要重复使用通过 PCB 板重新焊接移除或分离的三端保险丝。  
Please, Do Not Reuse the REP removed or detached by PCB re-work
    - PCB 重新焊接后，应按照以下步骤重新安装新的三端保险丝。  
After PCB Re-work, Re-mounting of NEW REP should be done as follow step.
      - 加热板：温度为 220±5°C，持续 3 秒  
Hot Plate: Temperature of 220 ± 5°C for 3sec.
      - 烙铁头退焊：温度为 300±5°C，持续 3 秒  
Iron: Temperature of 300 ± 5°C for 3sec.



Model DPM, DPB  
File Number: E213695

COMPANY

ZHONG SHAN LANBAO ELECTRICAL APPLIANCES CO LTD  
West Xing Pu Rd  
Huang Pu  
Zhongshan, Guangdong 528429 China

MODEL INFO

DPM, DPB f/b 04, 08, 12, 14, 20, 24, 30, 32, 40 or 50, f/b XX. XX are 01, 02, 03 thru 30.  
Supplemental micro fuses: surface mount, cartridge enclosed

| SUPPLEMENTAL FUSES | 额定值     |
|--------------------|---------|
| Micro Fuse         | Yes     |
| Pigtail Leads      | No      |
| Surface Mount      | Yes     |
| Cartridge Enclosed | Yes     |
| Time Delay         | No      |
| Paper Tube         | No      |
| Filled Tube        | No      |
| OD - Length        | 4 mm    |
| Length - Width     | 3 mm    |
| Height             | 0.95 mm |

| RATING TABLE     |                  |             |                |                         |
|------------------|------------------|-------------|----------------|-------------------------|
| Amps Minimum (A) | Amps Maximum (A) | Voltage (V) | Voltage Source | Interrupting Rating (A) |
| 1                | 30               | 36          | dc             | 50, 80                  |
| 1                | 30               | 48          | dc             | 50, 80                  |

**RATING TABLE**

| Amps Minimum (A) | Amps Maximum (A) | Voltage (V) | Voltage Source | Interrupting Rating (A) |
|------------------|------------------|-------------|----------------|-------------------------|
| 1                | 30               | 62          | dc             | 50, 80                  |

并不是所有出现在本数据库中的公司名称和产品都满足了UL 跟踪检验服务的要求。只有带有 UL 标志的产品，才应该被视为经过UL认证，并满足UL 跟踪检验服务的要求。注意查看产品上的标志。

UL 允许在线认证目录中所含材料的复制遵循以下条件：1.指南信息、装配、构造、设计、系统和/或认证（文件）必须在不篡改任何数据（或图纸）的情况下完整且无误导性地呈现。2.“经 UL 允许从在线认证目录转载”声明必须出现在所摘取材料的邻近位置。此外，转载材料必须包含以下格式的版权声明： "©2025 UL LLC."